
Wiring diagram ekey UPS DRM

Closed when no AC

power is available.



ID320/720: Version 2, 2019-05-28

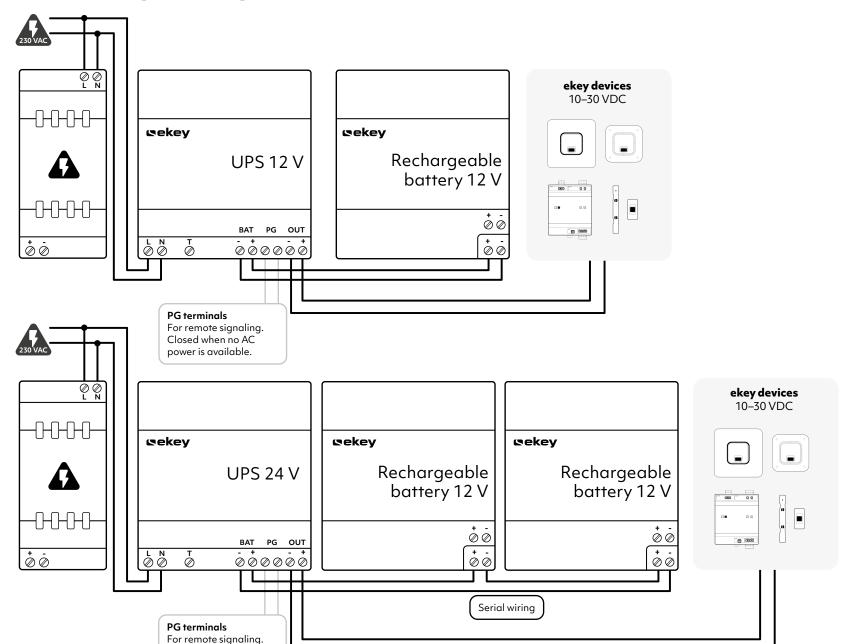

Pin Description
L: 100–240 VAC
N: 0 V (neutral)
T: potentiometer
BAT: rechargeable battery
PG: relay contact
OUT: 10–30 VDC

RECOMMENDED CABLE

J-Y(ST)Y with 0.6 or 0.8 mm²

A DANGER

Risk of electrocution: All ekey devices are to be operated with Safety Extra Low Voltage (SELV). Only use power supplies rated protection class 2 with safety approval according to EN 62368-1. Failure to do so will create a risk of fatal electrocution.

Only certified electricians are authorized to carry out electrical installation work on mains systems.

▲ ATTENTION

Property damage in the event of incorrect mounting and wiring: The system devices are operated using electricity.
They could be destroyed if they are mounted and wired incorrectly.
Mount and wire the system devices correctly before connecting the power.

NOTICE

This wiring diagram is not subject to updating. We reserve the right to make technical modifications and change the product's appearance; any liability for errors and misprints is excluded.